

UL489

UL508

UL1077

Typical Motor Group Installation
(see NEC® article 430.53 for reference and more information).



**Altech's V-EA UL508
Manual Motor Controllers
are approved for
Group Installations**


Disclaimer: This is an application example. Installation should be done by a qualified electrician under the guidance of UL/NEC® specifications.

Typical Motor Group Installation

(see NEC® article 430.53 for reference and more information).

**APPLICATION
EXAMPLE**

UL508A PANEL

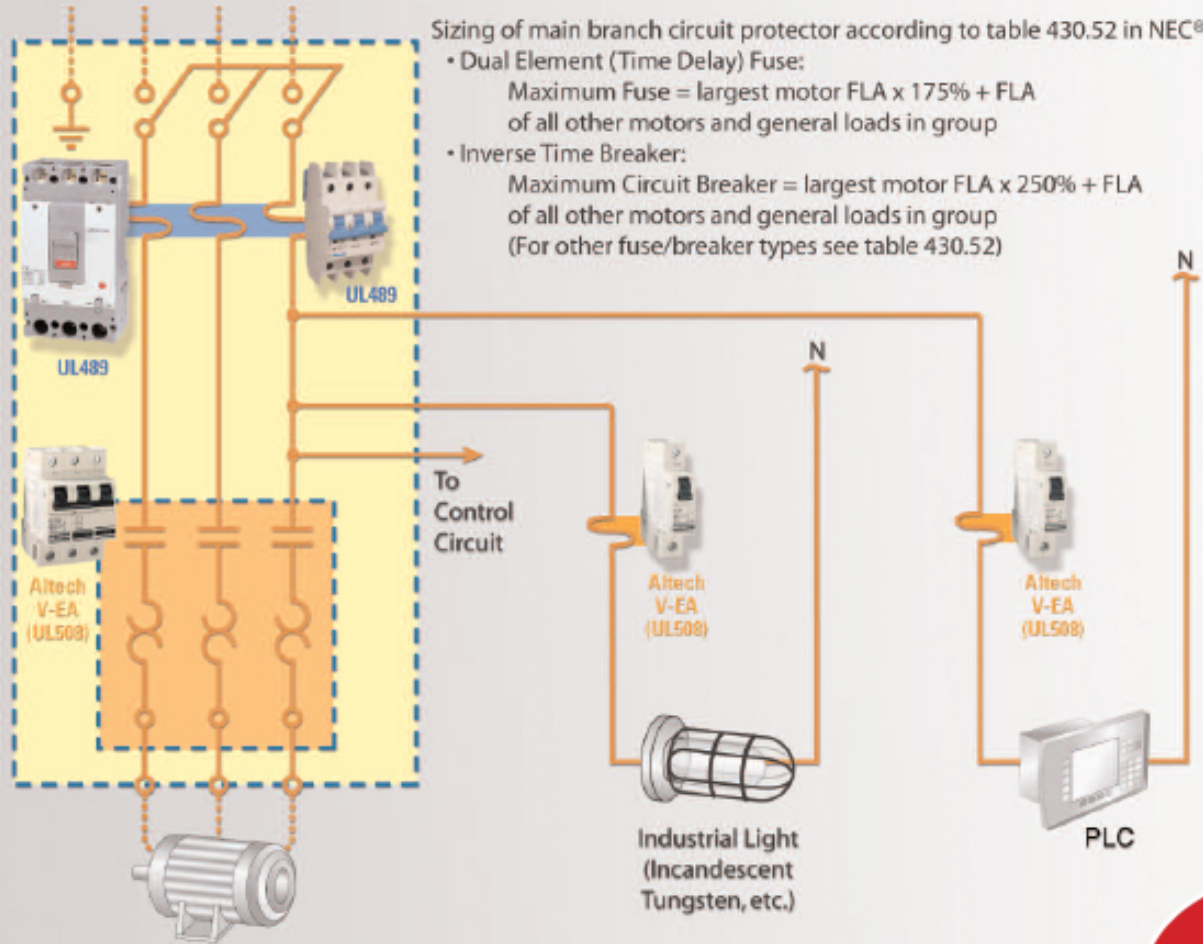

* Size overload protection according to NEC® 430.32 (1)

**V-EA UL508
Manual Motor Controllers
are approved for
Group Installations**

Disclaimer: This is an application example. Installation should be done by a qualified electrician under the guidance of UL/NEC® specifications.

UL489

UL508

UL1077